


**PROFORMA REGARDING SAFE DRINKING WATER AND SANITARY
CONDITION CERTIFICATE**

No. 3926

Date: 13/08/2026

It is certified that an inspection team headed by Deputy CMO G.B. Nagar. **Ramagya School, Bishara Road, Dadri, Gr. Noida, G.B Nagar** on dated 12-08-2026 and found that **Ramagya School** has safe drinking water facilities for the students and members of staff of the institution and is maintaining the hygienic sanitation condition in the school building & the campus as per the norms prescribed by the Central/State/U.T. Govt.

The above valid for a period of 1 Year.

Signature with Seal:- 
Chief Medical Officer
Name:- Gautam Buddha Nagar
Dr. Madan Mohan Mani Tripathi
Designation:- Chief Medical Officer

To

The Principal,
Ramagya School
Bishara Road, Dadri, Gr. Noida,
Gautam Budh Nagar.





SHRI OM TESTING & RESEARCH LABORATORY

Plot No. 296, 1st FNG Road, Sector-121, Ghari Chaukhandi, Noida-201301

Mob.: 9821154906, 8076937396, 9599753719

E-mail.: shriomlab@gmail.com, Web.: www.shriomlab.com, www.shriomlab.in

GSTIN: 09ADHFS2444J1ZS

N.A.B.L. Accredited, ISO 9001, ISO 14001 & ISO 45001 Certified Laboratory.

TEST- REPORT

Issued To: RAMAGYA SCHOOL

Address : Bishara Road Dadri Nagla Kirani
Uttar Pradesh 203207

Report No: STRL 08082026009

Date of Completion: 08.08.2026

SOURCE OF WATER: RO WATER (DRINKING WATER)

RESULTS

(WATER QUALITY ANALYSIS)

(As per IS 10500-2012)

SAMPLING DETAILS

Reference Protocol : As per IS: 10500-2012
Sampling Protocol : IS-3025(P-1)1987
Sample Received On : 03.08.2026
Sample Collected From : RAMAGYA SCHOOL
Bishara Road Dadri Nagla Kirani, Uttar Pradesh 203207
Sample Collected By : STRL STAF (UTKARSH BHARDWAJ)
Sampling Quantity : 2 Liter +500ml Sterilized Bottle
Sample Packing : Pet Bottle
Analysis Duration : 04.08.2026 to 08.08.2026

S. No.	Parameters	Units	Limits (as per IS:10500-2012)		Results	CONFORMITY	Test Method
			Desirable Limit	Permissible Limit			
PHYSICO-CHEMICAL TEST RESULTS :-							
01	Color	Hazen	5	15	<5	Yes	IS: 3025(Pt-4) 1983, Reaff2017
02	Taste	-	Agreeable	Agreeable	Agreeable	Yes*	IS: 3025(Pt-8)-1984, Reaff2017
03	Temperature	°C	-	-	24.0	Yes	IS: 3025(Pt-8)-1984, Reaff2017
04	Electric Conductivity	µS/cm	-	-	143.4	Yes	IS: 3025(Pt-14)2013
05	pH	-	6.5-8.5	No Relaxation	7.36	Yes	IS: 3025(Pt-11)1983, Reaff2017
06	TDS	mg/l	500	2000	86.1	Yes	IS: 3025(Pt-16)1984, Reaff2017
CHEMICAL TEST RESULTS :-							
07	Iron as (Fe)	Mg/l	0.3	No Relaxation	0.01	Yes	APHA23nd ED. 2017,3120B
08	Total Hardness (as CaCO ₃)	mg/l	200	600	34.2	Yes	IS: 3025(Pt-21)1983, Reaff2014

Page (01 of 02)



For Shri Om Testing & Research Laboratory

08/08/26
ISHWAR BHARDWAJ
Technical Manager

Authorised Signatory
(Name, Designation & Signature with Seal)



SHRI OM TESTING & RESEARCH LABORATORY

Plot No. 296, 1st FNG Road, Sector-121, Ghari Chaukhandi, Noida-201301
Mob.: 9821154906, 8076937396, 9599753719
E-mail.: shriomlab@gmail.com, **Web.:** www.shriomlab.com, www.shriomlab.in

GSTIN: 09ADHFS2444J1ZS

N.A.B.L. Accredited, ISO 9001, ISO 14001 & ISO 45001 Certified Laboratory.

TEST- REPORT

Report No: STRL 08082026009

S. No.	Parameters	Units	Limits (as per IS:10500-2012)		Results	CONFORMITY	Test Method
			Desirable Limit	Permissible Limit			
09	Chlorides (as Cl)	mg/l	250	1000	18.2	Yes	IS: 3025(Pt-32)1988, Reaff2014
10	Fluoride (as F)	mg/l	1	1.5	0.01	Yes	APHA 22 nd Ed., 4500F(D)
11	Sulphate (as SO ₄)	mg/l	200	400	12.2	Yes	IS: 3025(Pt-24)1986, Reaff2014
12	Nitrate	mg/l	45	No Relaxation	11.4	Yes	IS: 3025 (Pt-34)1988, Reaff2014
13	Calcium (as Ca ²⁺)	mg/l	75	200	10.2	Yes	IS :3025(Pt-40)1991, Reaff.2014
14	Magnesium (as Mg ²⁺)	mg/l	30	100	2.1	Yes	APHA 22 nd Ed., 3500-Mg (B)
15	Chromium Hexavalent (as Cr ⁶⁺)	mg/l	0.05	No Relaxation	0.05	Yes	IS: 3025 (Pt-52) 2003, Reaff 2014
16	Zinc (as Zn)	mg/l	5	15	0.2	Yes	APHA 23 rd Ed. 2017, 3120 B / 3111 B (AAS)
17	Lead (as Pb)	mg/l	0.01	No Relaxation	<0.01	Yes	APHA 23 rd Ed. 2017, 3120 B / 3111B AAS
18	Phenolic Compounds (as C ₆ H ₅ OH)	mg/l	0.001	0.002	<0.001	Yes	APHA 23 rd Ed. 2017, 5530 C
19	Alkalinity (as CaCO ₃)	mg/l	200	600	32.6	Yes	IS: 3025(Pt-23)1986, Reaff014


BACTERIOLOGICAL PARAMETERS :-

1	Total Coli form	MPN/100ml	Should be absent	Absent	Yes	IS: 1622-1981 (Reaff.2003)
2	E. Coli	E. Coli/100ml	Should be absent	Absent	Yes	IS: 1622-1981 (Reaff.2003)

Remarks: The Sample Confirm IS-10500-2012 (DRINKING WATER) Specification, w.r.t for above Parameters

****End of Report****

Page (02 of 02)

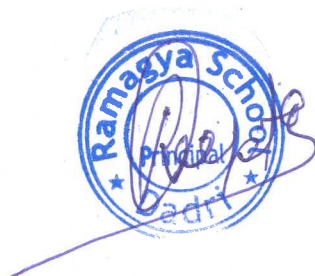

For Shri Om Testing & Research Laboratory

[Signature] 08/08/26
ISHWAR BHARDWAJ
 Technical Manager

Authorised Signatory
 (Name, Designation & Signature with Seal)